



International Scientific Instruments



(Importers and Distributors of Electronic Equipment)
140 Darling Road, East Malvern, Vic. 3145, Australia
PO Box 1215
Darling, Vic. 3145, Australia
Telephone: (03) 9571 7719 International: 61 3 9571 7719
Fax: (03) 9571 9977 International: 61 3 9571 9977
E-mail: sales@interscientific.com.au
Web: www.interscientific.com.au

VIBRATION CONDITION MONITORING SYSTEM Screw-in M8 X 1/4-28 UNF Accelerometer Mounting Stud

PART NO.: M/1428 M8
MATERIAL: Grade 303 Stainless Steel

REV B

\$25 plus GST

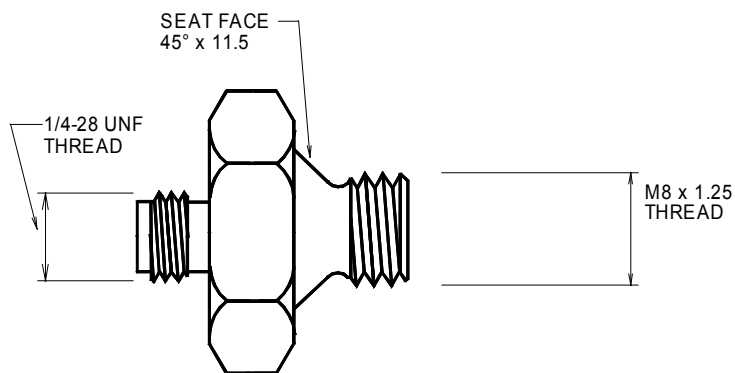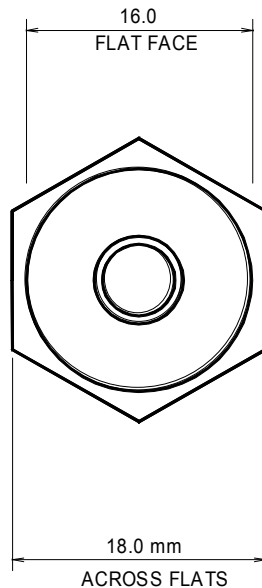

INSTALLATION

1. Drill a 6.8 mm (17/64") diameter hole x 9 mm deep (i.e. 11.5 mm max. hole depth to drill point) at the selected monitoring location. (NB. The stud location should allow sufficient clearance for use of either a 26 mm or a 42 mm diameter accelerometer.)
2. Machine a chamfered mounting seat using a 90° countersinking tool to provide no more than 1-1.5 mm wide seat face.
3. Tap hole with an M8 x 1.25 mm pitch thread to provide 8 mm of full thread.
NB. Use a plug tap and ensure that the hole and thread are thoroughly cleaned out.
4. Install the stud to seat evenly on the countersink and lightly torque to 10-15 Nm. It is important that the stud does not bottom in the hole or mate with the machine surface except by the seat face. (These conditions can produce excessive / reduced transmitted vibration levels.)
NB. Use a thread locking compound (eg Loctite) on machines with high vibration.

